

13 March 2026

ADDENDUM NO. 2

RE: Leon, KS
Water System Improvements – Phase #2
WCI File: 23-600-636-00

To All Prospective Bidders:

The Contract Documents for the referenced project are hereby amended in the following particulars only, with all other conditions remaining unchanged.

A. Plans

1. Sheet C-103
REMOVE existing sheet C-103 and REPLACE with attached sheet C-103 which REMOVES an abandonment note on the connection South of the intersection of Olive St & High St in Viewport A1.
2. Sheet No. C-502
REMOVE existing sheet C-502 and REPLACE with attached sheet C-502 which MODIFIES Note #3 in detail A4.
3. Sheet No. C-501
CLARIFICATION for Detail F7 on Sheet C-501 that existing setter inlet size is typical ¾". Contractor responsible for necessary fittings to connect with new 1" water service lines.

B. PROJECT MANUAL

1. Section 00410 – Bid Form:
REMOVE and REPLACE Section 00410 Bid Form with new attached section that includes a MODIFIED quantity for line item #13 Rock Excavation. The attached Bid Form also breaks down line items #11 and #12 by existing water line pipe diameter at connections and abandonment locations.



This ADDENDUM is hereby made a part of the Bidding Documents to the same extent as though contained in the original documents. Work to be included shall not be limited to narrative description contained herein, but shall also include adjustments or revisions to other work not mentioned, in order to accomplish the Work described.



Each Bidder shall acknowledge receipt of this ADDENDUM in the space provided on the Bid Form.

WILSON & COMPANY

A handwritten signature in blue ink that reads "Colton Woodard". The signature is written in a cursive style.

Colton Woodard
Project Manager

3/13/2026 W:\Projects\2360063600\09_CADD\04_Sheets\Civil\2360063600_WL.dwg

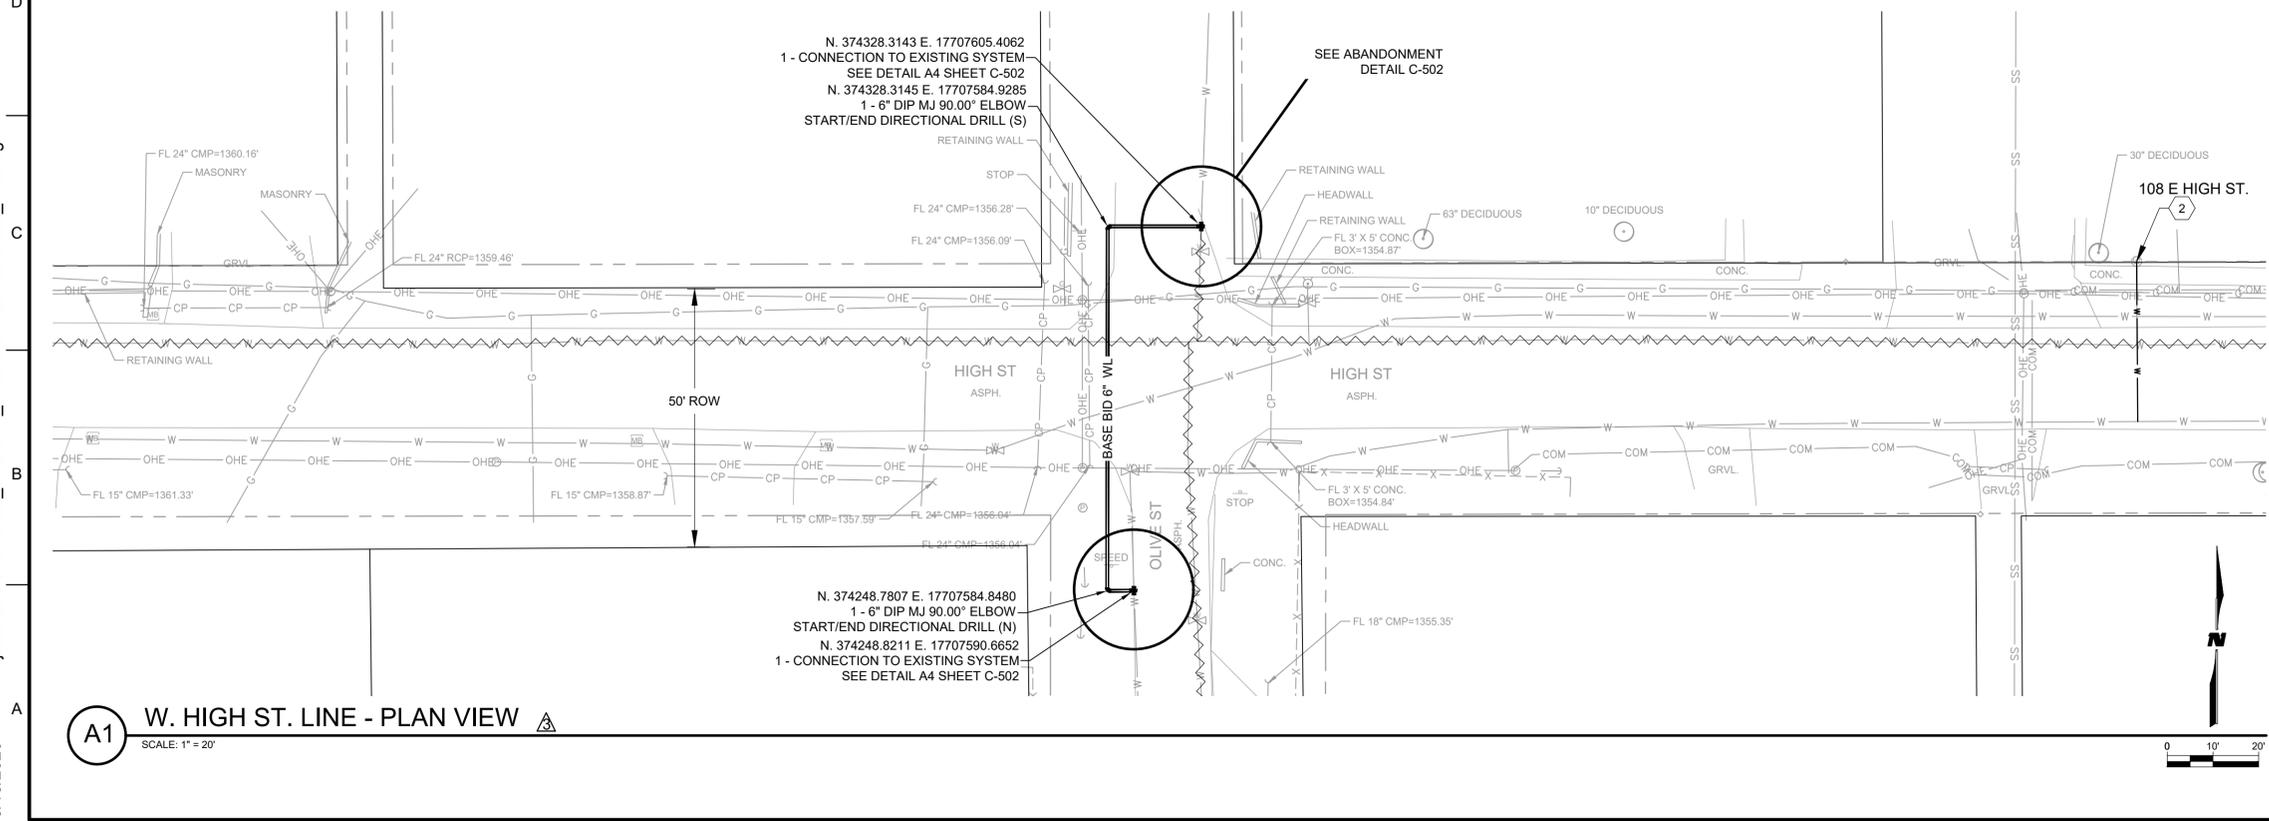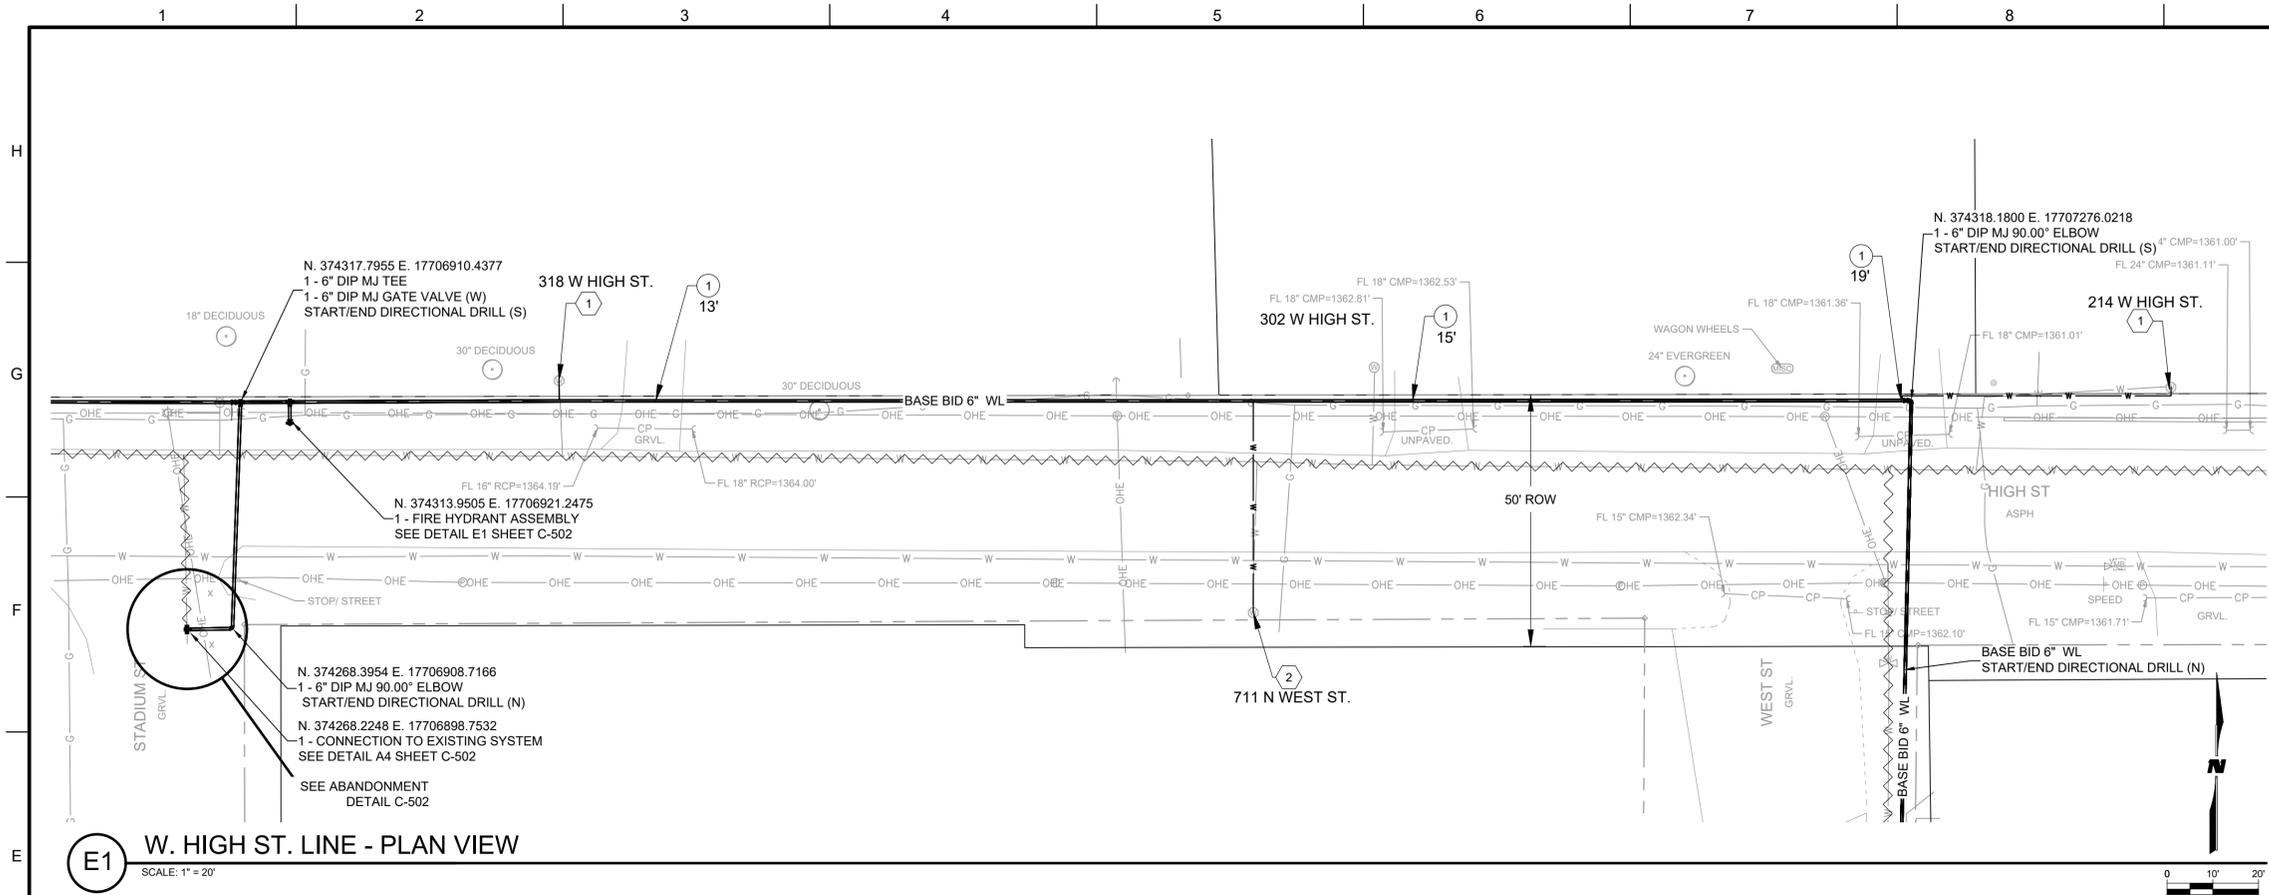


KEYNOTES

① REMOVE AND REPLACE GRAVEL SURFACING
 XX' = L.F. OF SURFACING REPLACEMENT

② REMOVE AND REPLACE ASPHALT SURFACING
 XX' = L.F. OF SURFACING REPLACEMENT

③ REMOVE AND REPLACE CONCRETE SURFACING
 XX' = L.F. OF SURFACING REPLACEMENT

WILSON & COMPANY
 1700 EAST IRON AVE
 SALINA, KS 67401
 PHONE: 785-827-0433
 FAX: 785-827-5949
 www.wilsonco.com



CONSULTANTS

SEAL

PROJECT NAME
**CITY OF LEON, KS
 WATER SYSTEM
 IMPROVEMENTS PHASE 2**


REV.	DATE	DESCRIPTION	BY
A	03/13/26	ADDENDUM #2	CJW
A	02/04/26	WATER METER REPORT	CJW

PROJECT NO: 2360063600
 DESIGNED BY: CJW
 DRAWN BY: BR
 CHECKED BY: DAG
 DATE: OCTOBER 2025

SHEET TITLE
**WATERLINE PLAN
 BASE BID**


SHEET NO:
C-103

3/13/2026 W:\Projects\2360063600\09_CADD\04_Sheets\Civil\2360063600_MD.dwg

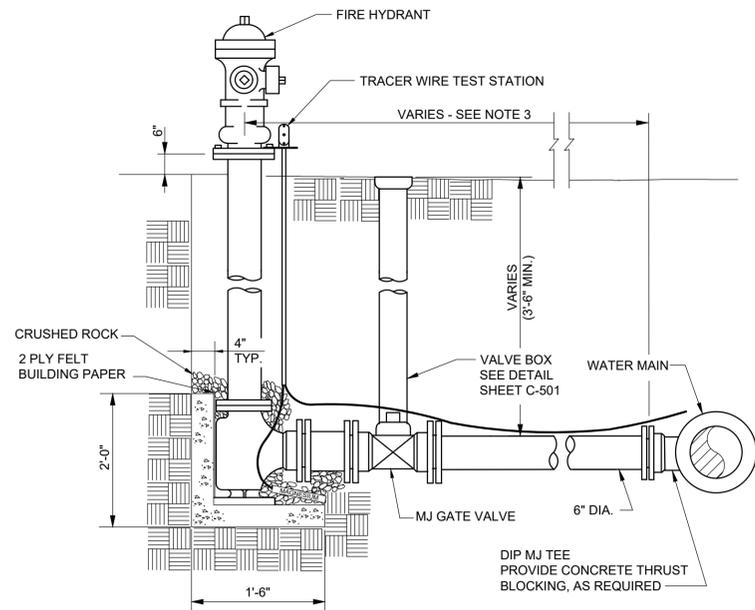


- NOTES:**
- HYDRANTS SHALL BE SET IN 8 CUBIC FEET OF CRUSHED STONE TO ALLOW FOR PROPER DRAINAGE OF THE HYDRANT. RECOMMENDATIONS OF THE AWWA SHOULD BE FOLLOWED WHEN INSTALLING THE HYDRANTS.
 - CONTRACTOR TO FIELD VERIFY HYDRANT BURY DEPTH OR PROVIDE ADJUSTABLE EXTENSIONS AS REQUIRED.
 - 4' MIN. REQUIRED. CONTRACTOR TO PROVIDE ADDITIONAL PIPE TO LOCATE HYDRANT IN LOCATION SHOWN ON DRAWINGS.

E1 FIRE HYDRANT ASSEMBLY DETAIL
NOT TO SCALE

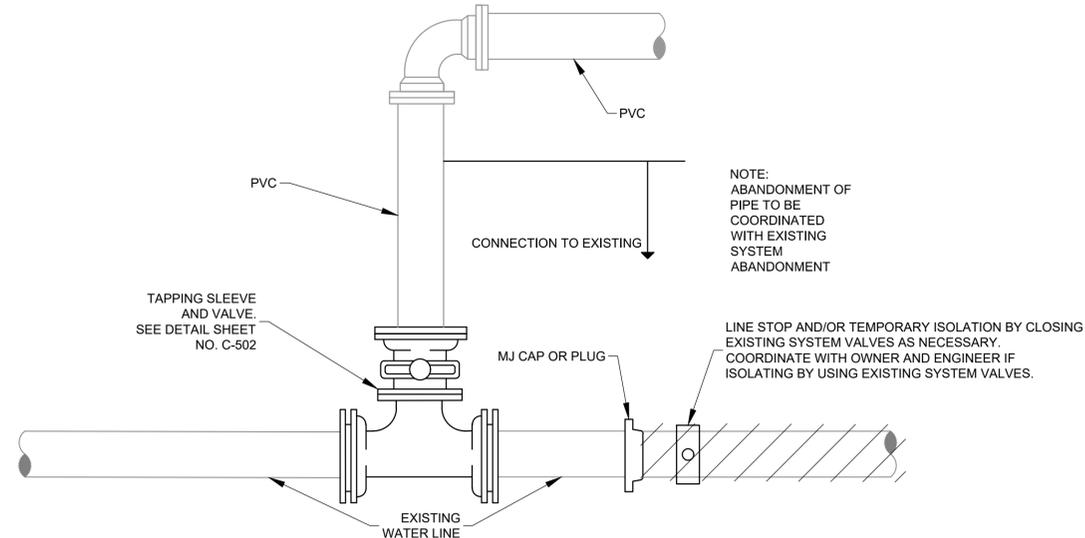


F4 ABANDONMENT DETAIL - TAPPING SLEEVE AND VALVE
NOT TO SCALE

- NOTE:**
ABANDONMENT OF PIPE TO BE COORDINATED WITH EXISTING SYSTEM ABANDONMENT.
- LINE STOP AND/OR TEMPORARY ISOLATION BY CLOSING EXISTING SYSTEM VALVES AS NECESSARY. COORDINATE WITH OWNER AND ENGINEER IF ISOLATING BY USING EXISTING SYSTEM VALVES.

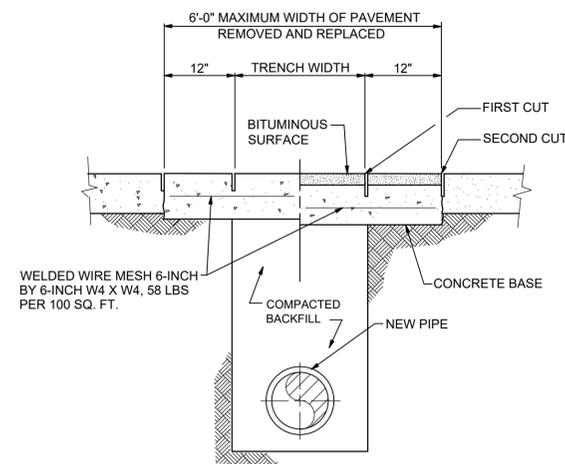

- NOTE:**
- REPLACEMENT PAVEMENT SHALL HAVE A SUBGRADE BASE AS SPECIFIED. THE BITUMINOUS SURFACE SHALL BE 2" (MIN.) THICKNESS. BITUMINOUS SURFACE SHALL BE IN ACCORDANCE WITH KANSAS DEPT. OF TRANSPORTATION SPECIFICATIONS AC-5.
 - REPLACEMENT CONCRETE SHALL BE 6" THICK MINIMUM OR TO MATCH EXISTING THICKNESS IF GREATER- 4,000 PSI.


A1 PAVEMENT REPLACEMENT DETAIL
NOT TO SCALE

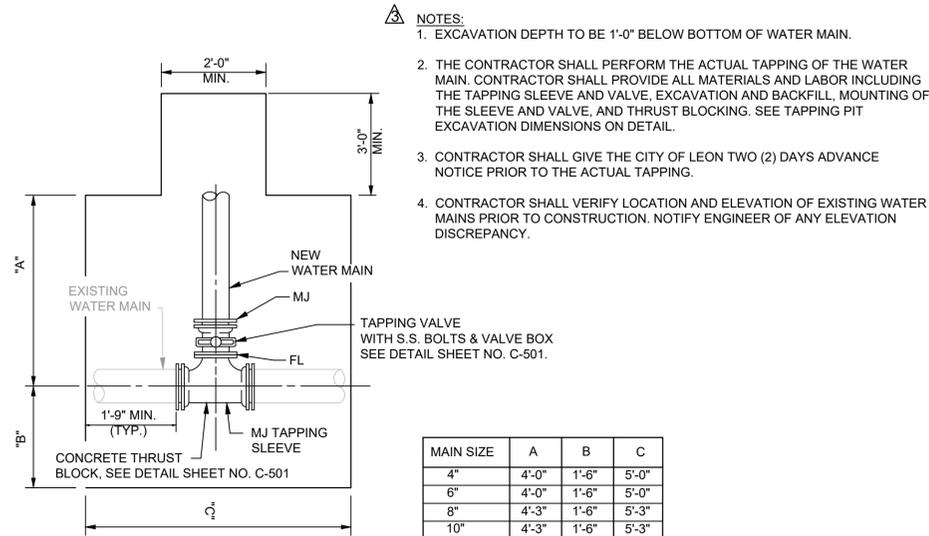

- NOTES:**
- EXCAVATION DEPTH TO BE 1'-0" BELOW BOTTOM OF WATER MAIN.
 - THE CONTRACTOR SHALL PERFORM THE ACTUAL TAPPING OF THE WATER MAIN. CONTRACTOR SHALL PROVIDE ALL MATERIALS AND LABOR INCLUDING THE TAPPING SLEEVE AND VALVE, EXCAVATION AND BACKFILL, MOUNTING OF THE SLEEVE AND VALVE, AND THRUST BLOCKING. SEE TAPPING PIT EXCAVATION DIMENSIONS ON DETAIL.
 - CONTRACTOR SHALL GIVE THE CITY OF LEON TWO (2) DAYS ADVANCE NOTICE PRIOR TO THE ACTUAL TAPPING.
 - CONTRACTOR SHALL VERIFY LOCATION AND ELEVATION OF EXISTING WATER MAINS PRIOR TO CONSTRUCTION. NOTIFY ENGINEER OF ANY ELEVATION DISCREPANCY.

MAIN SIZE	A	B	C
4"	4'-0"	1'-6"	5'-0"
6"	4'-0"	1'-6"	5'-0"
8"	4'-3"	1'-6"	5'-3"
10"	4'-3"	1'-6"	5'-3"
12"	4'-6"	1'-8"	5'-6"

A4 TAPPING SLEEVE AND VALVE DETAIL
NOT TO SCALE

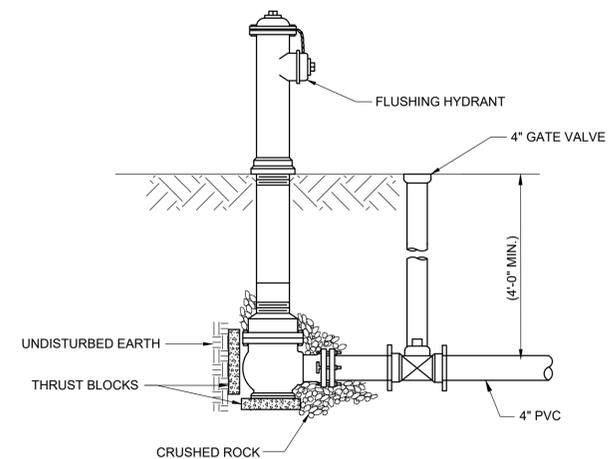

- NOTES:**
- HYDRANTS SHALL BE SET IN 8 CUBIC FEET OF CRUSHED STONE TO ALLOW FOR PROPER DRAINAGE OF THE HYDRANT. RECOMMENDATIONS OF THE AWWA SHOULD BE FOLLOWED WHEN INSTALLING THE HYDRANTS.
 - CONTRACTOR TO FIELD VERIFY HYDRANT BURY DEPTH OR PROVIDE ADJUSTABLE EXTENSIONS AS REQUIRED.

A8 FLUSHING HYDRANT ASSEMBLY
NOT TO SCALE

WILSON & COMPANY
1700 EAST IRON AVE
SALINA, KS 67401
PHONE: 785-827-0433
FAX: 785-827-5949
www.wilsonco.com



CONSULTANTS

SEAL

CITY OF LEON, KS
WATER SYSTEM
IMPROVEMENTS PHASE 2

REV.	DATE	ADDENDUM #2	DESCRIPTION	C/JW	BY
1	03/13/26				

PROJECT NO: 2360063600
DESIGNED BY: CJW
DRAWN BY: BR
CHECKED BY: DAG
DATE: OCTOBER 2025

SHEET TITLE
MISCELLANEOUS
DETAILS

SHEET NO:
C-502

SECTION 00410 – BID FORM

The terms used in this Bid with initial capital letters have the meanings stated in the Instructions to Bidders, the General Conditions, and the Supplementary Conditions.

ARTICLE 1—OWNER AND BIDDER

- 1.01 This Bid is submitted to: City of Leon, KS – 111 S. Main St, Leon, KS 67074
- 1.02 The undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into an Agreement with Owner in the form included in the Bidding Documents to perform all Work as specified or indicated in the Bidding Documents for the prices and within the times indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents.

ARTICLE 2—ATTACHMENTS TO THIS BID

- 2.01 The following documents are submitted with and made a condition of this Bid:
 - A. Required Bid security;
 - B. List of Proposed Subcontractors;
 - C. Evidence of authority to do business in the state of the Project; or a written covenant to obtain such authority within the time for acceptance of Bids;
 - D. Contractor’s license number as evidence of Bidder’s State Contractor’s License or a covenant by Bidder to obtain said license within the time for acceptance of Bids;
 - E. KDHE State Revolving Loan Fund;
 - 1. State of Kansas Act Against Discrimination Contract Provision Certification Form
 - 2. Demonstration of Compliance with DBE Good Faith Efforts Worksheet
 - 3. Certification Regarding Lobbying
 - 4. Build America Buy America Certification

ARTICLE 3—BASIS OF BID—UNIT PRICES

- 3.01 *Total Base Bid Price (Unit Prices)*
 - A. Bidder will complete the Work including all equipment, materials, labor and installation in accordance with the Contract Documents for the following price(s):

TOTAL BASE BID PRICE*:

_____ Dollars (\$_____).

B. Bidder acknowledges that:

1. each Bid Unit Price includes an amount considered by Bidder to be adequate to cover Contractor's overhead and profit for each separately identified item, and
2. estimated quantities are not guaranteed and are solely for the purpose of comparison of Bids, and final payment for all Unit Price Work will be based on actual quantities, determined as provided in the Contract Documents.

BID FORM ATTACHMENT A: WATER SYSTEM IMPROVEMENTS – PHASE 2

Bid Item	Item Description	Unit	Estimated Quantity	Unit Price	Amount
General:					
1	Mobilization	L.S.	1		
2	Construction Staking	L.S.	1		
3	Erosion Control	L.S.	1		
4	Grass Seeding	L.S.	1		
				<i>SUBTOTAL</i>	
Water System Improvements:					
5	Waterline Piping by Trenching, PVC				
	4-inch	L.F.	1,230		
	6-inch	L.F.	8,935		
6	Waterline Piping by Directional Drill, PVC				
	4-inch	L.F.	146		
	6-inch	L.F.	3,470		
7	Gate Valve Assembly				
	4-inch	EA	3		
	6-inch	EA	23		
8	Fire Hydrant Assembly	EA	21		
9	Flushing Hydrant Assembly	EA	1		
10	Water Service Connection				
	Short Service	EA	102		
	Long Service	EA	97		
11	Connections to Existing System				
	6" Existing System Connection	EA	14		
	4" Existing System Connection	EA	8		
	2" Existing System Connection	EA	1		
12	Existing System Abandonment				
	6" Existing System Abandonment	EA	9		
	4" Existing System Abandonment	EA	9		
	2" Existing System Abandonment	EA	1		
13	Rock Excavation	CY	530		
14	6" Insertion Valve	EA	1		
15	Removal and Replacement of Surfacing				
	Gravel	LF	972		
	Asphalt	LF	31		
	Concrete	LF	108		
16	Meter Pit & Lid Replacement	EA	199		
17	2-inch Splash Park Connection	L.S.	1		
				<i>SUBTOTAL</i>	
TOTAL BASE BID PRICE					

EJCDC® C-410, Bid Form for Construction Contract.
 Copyright© 2018 National Society of Professional Engineers, American Council of Engineering Companies,
 and American Society of Civil Engineers. All rights reserved.

3.02 *Alternates:* The Owner reserves the right to accept or reject the following alternates. Upon acceptance of the alternate(s) by the Owner, the named items shall be furnished, removed, or adjusted as shown on the Drawings and as specified. The Total Bid Price will be modified accordingly. A bid must be received for all alternates if a bid is submitted.

The following Alternates shall be composed of the following work: Furnishing all costs in connection with labor, materials, and equipment necessary to construct the proposed waterline as shown on the drawings. The materials and equipment include pipe and fittings; valves; hydrants; seals; tracer wire; temporary isolations; open trenching and over excavation of trench; trench stabilization; shoring and bracing as required; dewatering as necessary; standard excavation; discovery and protection of subsurface obstructions; fine grading and shaping trench bottoms; disposal of surplus and waste materials; disinfecting and flushing of waterline; grading; traffic control; providing fill dirt as necessary; notification and coordination with homeowners; grass seeding; removal and replacement of surfacing; water service connection; and all other incidental and appurtenant work required to complete this item. Subsidiary items shall include construction staking, clearing and grubbing and erosion control as pertinent to the indicated Alternate. The quantity stated within the Alternate will be the pay quantity for this item unless either party has reason to believe the final quantity has varied significantly from the base bid quantity.

Bid Item	Item Description	Unit	Estimated Quantity	Unit Price	Amount
Addition for Alternate No. 1					
5	Waterline Piping by Trenching, 6" PVC	LF	310		
10	Water Service Connection				
	Short Service	EA	2		
	Long Service	EA	4		
15	Removal and Replacement of Surfacing				
	Gravel	LF	48		

Total Addition for Alternate No. 1 _____

Bid Item	Item Description	Unit	Estimated Quantity	Unit Price	Amount
Addition for Alternate No. 2					
5	Waterline Piping by Trenching, 6" PVC	LF	553		
10	Water Service Connection				
	Short Service	EA	3		
	Long Service	EA	2		
15	Removal and Replacement of Surfacing				
	Gravel	LF	56		

Total Addition for Alternate No. 2 _____

Bid Item	Item Description	Unit	Estimated Quantity	Unit Price	Amount
Addition for Alternate No. 3					
5	Waterline Piping by Trenching, 6" PVC	LF	275		
10	Water Service Connection				
	Short Service	EA	3		
	Long Service	EA	3		
15	Removal and Replacement of Surfacing				
	Gravel	LF	24		

Total Addition for Alternate No. 3 _____

Deduction for Alternate No. 3					
14	6" Insertion Valve	EA	1		

Total Deduction for Alternate No. 3 _____

Alternate No. 4:

Utility Locator. This item shall include all costs in connection with furnishing and installing the utility locator equipment; (Subsite Model Utiliguard 2) complete with transmitter; receiver; and all necessary accessories to accurately locate buried telephone, CATV, power, gas and water/sewer lines; training; testing; troubleshooting; and all other incidental and appurtenant work required to complete this item.

Bid Item	Item Description	Unit	Estimated Quantity	Unit Price	Amount
Addition for Alternate No. 4					
	Utility Locator	EA	1		
Total Addition for Alternate No. 4					

ARTICLE 4—TIME OF COMPLETION

- 4.01 Bidder agrees that the Work will be substantially complete on or before _____, and completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions on or before _____.
- 4.02 Bidder accepts the provisions of the Agreement as to liquidated damages.

ARTICLE 5—BIDDER’S ACKNOWLEDGEMENTS: ACCEPTANCE PERIOD, INSTRUCTIONS, AND RECEIPT OF ADDENDA

- 5.01 *Bid Acceptance Period*
 - A. This Bid will remain subject to acceptance for 60 days after the Bid opening, or for such longer period of time that Bidder may agree to in writing upon request of Owner.
- 5.02 *Instructions to Bidders*
 - A. Bidder accepts all of the terms and conditions of the Instructions to Bidders, including without limitation those dealing with the disposition of Bid security.
- 5.03 *Receipt of Addenda*
 - A. Bidder hereby acknowledges receipt of the following Addenda:

Addendum Number	Addendum Date

ARTICLE 6—BIDDER’S REPRESENTATIONS AND CERTIFICATIONS

- 6.01 *Bidder’s Representations*
 - A. In submitting this Bid, Bidder represents the following:
 - 1. Bidder has examined and carefully studied the Bidding Documents, including Addenda.
 - 2. Bidder has visited the Site, conducted a thorough visual examination of the Site and adjacent areas, and become familiar with the general, local, and Site conditions that may affect cost, progress, and performance of the Work.
 - 3. Bidder is familiar with all Laws and Regulations that may affect cost, progress, and performance of the Work, including all American Iron and Steel requirements.
 - 4. Bidder has carefully studied the reports of explorations and tests of subsurface conditions at or adjacent to the Site and the drawings of physical conditions relating to existing surface or subsurface structures at the Site that have been identified in the Supplementary Conditions, with respect to the Technical Data in such reports and drawings.
 - 5. Bidder has carefully studied the reports and drawings relating to Hazardous Environmental Conditions, if any, at or adjacent to the Site that have been identified in

the Supplementary Conditions, with respect to Technical Data in such reports and drawings.

6. Bidder has considered the information known to Bidder itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Bidding Documents; and the Technical Data identified in the Supplementary Conditions or by definition, with respect to the effect of such information, observations, and Technical Data on (a) the cost, progress, and performance of the Work; (b) the means, methods, techniques, sequences, and procedures of construction to be employed by Bidder, if selected as Contractor; and (c) Bidder's (Contractor's) safety precautions and programs.
7. Based on the information and observations referred to in the preceding paragraph, Bidder agrees that no further examinations, investigations, explorations, tests, studies, or data are necessary for the performance of the Work at the Contract Price, within the Contract Times, and in accordance with the other terms and conditions of the Contract.
8. Bidder is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Bidding Documents.
9. Bidder has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Bidder has discovered in the Bidding Documents, and of discrepancies between Site conditions and the Contract Documents, and the written resolution thereof by Engineer is acceptable to Contractor.
10. The Bidding Documents are generally sufficient to indicate and convey understanding of all terms and conditions for performance and furnishing of the Work.
11. The submission of this Bid constitutes an incontrovertible representation by Bidder that without exception the Bid and all prices in the Bid are premised upon performing and furnishing the Work required by the Bidding Documents.

6.02 *Bidder's Certifications*

A. The Bidder certifies the following:

1. This Bid is genuine and not made in the interest of or on behalf of any undisclosed individual or entity and is not submitted in conformity with any collusive agreement or rules of any group, association, organization, or corporation.
2. Bidder has not directly or indirectly induced or solicited any other Bidder to submit a false or sham Bid.
3. Bidder has not solicited or induced any individual or entity to refrain from bidding.
4. Bidder has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for the Contract. For the purposes of this Paragraph 8.02.A:
 - a. Corrupt practice means the offering, giving, receiving, or soliciting of anything of value likely to influence the action of a public official in the bidding process.
 - b. Fraudulent practice means an intentional misrepresentation of facts made (a) to influence the bidding process to the detriment of Owner, (b) to establish bid prices at

artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition.

- c. Collusive practice means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish bid prices at artificial, non-competitive levels.
- d. Coercive practice means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the bidding process or affect the execution of the Contract.

BIDDER hereby submits this Bid as set forth above:

Bidder:

(typed or printed name of organization)

By: _____
(individual's signature)

Name: _____
(typed or printed)

Title: _____
(typed or printed)

Date: _____
(typed or printed)

If Bidder is a corporation, a partnership, or a joint venture, attach evidence of authority to sign.

Attest: _____
(individual's signature)

Name: _____
(typed or printed)

Title: _____
(typed or printed)

Date: _____
(typed or printed)

Address for giving notices:

Bidder's Contact:

Name: _____
(typed or printed)

Title: _____
(typed or printed)

Phone: _____

Email: _____

Address: _____

Bidder's Contractor License No.: (if applicable) _____

END OF SECTION